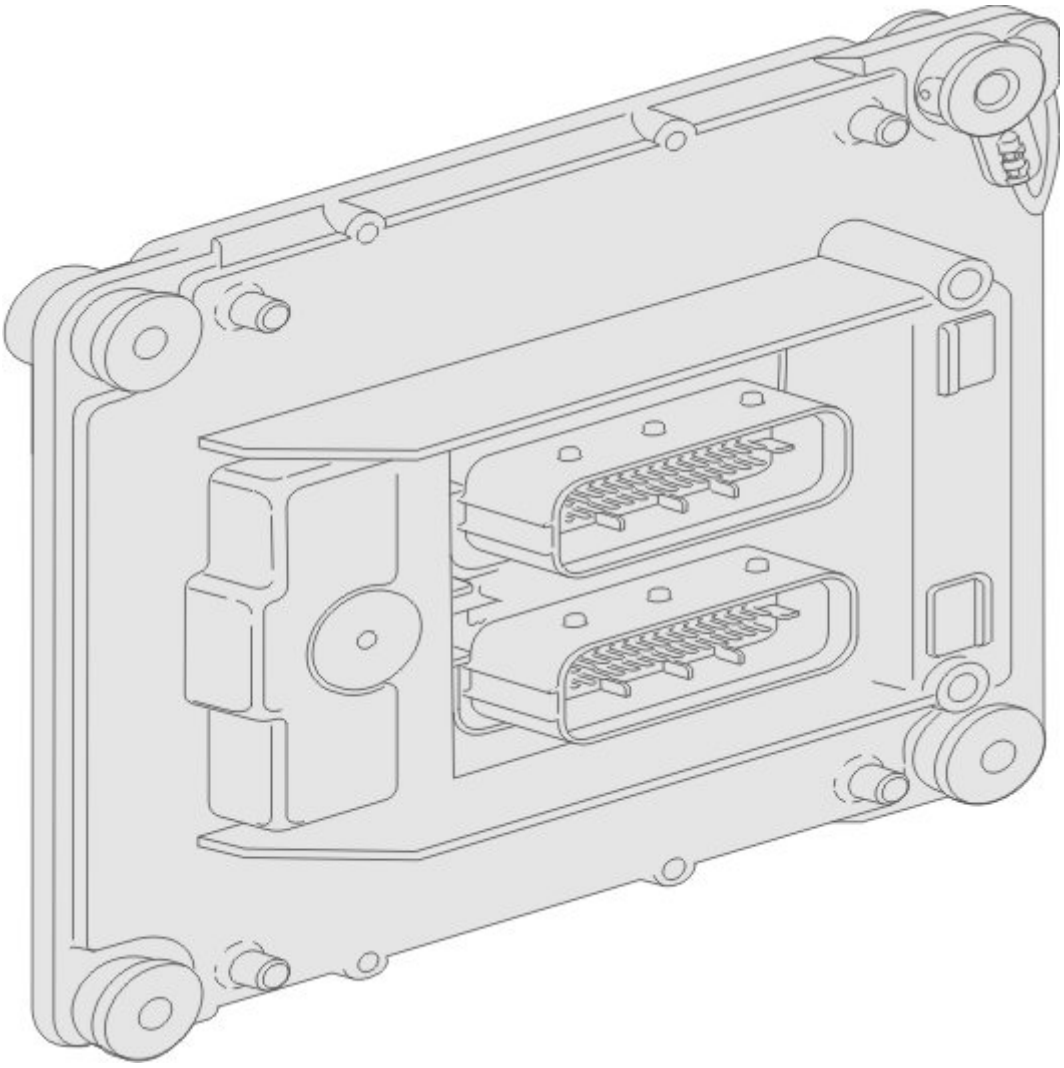


Fault type	Conditions for fault code	Observable symptoms	Probable cause
U1FFF FTB 68	• Factory Mode. • The function has been activated	• None	• Programming sequence interrupted

Action:

Conform the internal fault in Aftertreatment Control Module (ACM).